

TEST REPORT

(This Report is issued subject to the terms & conditions set out below)

Setesco Services Pte Ltd
18 Teban Gardens Crescent
Singapore 608925
Tel : (65) 6566 7777
Fax: (65) 6566 7718
www.setesco.com
Business Reg. No. 196900269D

Your Ref: Application Dated 26/04/2016

Our Ref: CT-35225/SS/1

Date: 29/04/2016


Page 1 of 2

Subject : Testing of GFRC materials, submitted by STA Construction Pte Ltd

Tested For : **STA Construction Pte Ltd**
21 Bukit Batok Crescent
#02-76 WCEGA Tower
Singapore 658065
Attn: Ms Sylvia Wong

Method of Test : Compressive Strength - ASTM C109

Description of Sample : The details as furnished by client are as follows:
Six (06) Specimens of GFRC cube size 50 mm x 50 mm x 50 mm
(See photograph attached)

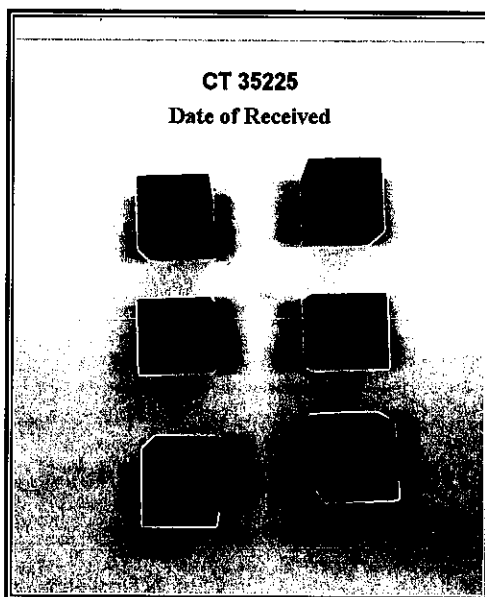

Results : Refer to results on page 2

lu

Gins

Terms & Conditions:


- (1) The Report is prepared for the sole use of the Client and is prepared based upon the Item submitted, the services required by the Client and the conditions under which the Services are performed by SETSCO. The Report is not intended to be representative of similar or equivalent Services on similar or equivalent items. The Report does not constitute an endorsement by SETSCO of the item.
- (2) SETSCO agrees to use reasonable diligence in the performance of the Services but no warranties are given and done may be implied directly or indirectly relating to the Services, the Report or the facilities of SETSCO.
- (3) The Report may not be used in any publicity material without the written consent of SETSCO.
- (4) The Report may not be reproduced in part or in full unless approval in writing has been given by SETSCO.
- (5) SETSCO shall under no circumstances be liable to the Client or its agents, servants or representatives, in contract, tort (including negligence or breach of statutory duty) or otherwise for any direct or indirect loss or damage suffered by the Client, its agents, servants or representative howsoever arising or wether connected with the Services provided by SETSCO herein.

Results:

Table 1 .Compressive Strength

Sample Reference	GFRC material					
Specimen Reference	1	2	3	4	5	6
Size of Cube (mm)	50 x 50 x 50					
Date of received	26/4/2016					
Date of Test	26/4/2016					
Compressive Strength (N/mm ²)	16.4	16.9	15.8	16.7	16.1	16.6
Average Compressive Strength (N/mm ²)	16.4					

F 
 Ashraf Iskandar Mar Dikarno
 Testing Officer


 Salim Suwignjo
 Principal Engineer (CMTD)
 Construction Technology Division